

Features

MX Technology addressable input/output module features:


- **Mini-IAMs** (Individual Addressable Module) provide remote monitoring of a single input and have a small size suitable for convenient mounting
- **Dual Input IAMs** provide remote monitoring of two Class B inputs or one Class A input
- **Relay IAMs** provide remote relay contact control
- **Signal IAMs** combine with 24 VDC to provide a 2 A local Class B or Class A operation Notification Appliance Circuit (NAC)
- **Monitor ZAMs** (Zone Adapter Module) provide local Initiating Device Circuit (IDC) operation, either dual Class B IDCs or single Class A IDC
- **Line Isolator Modules** monitor line condition and separates input from output to isolate short circuits
- Address is easily programmed with the MX Service Tool
- Modules (except 4090-5201 Mini-IAM) are mounted in a cover assembly that provides access to the address setting port and allows viewing of the LED status indicator
- Modules with covers mount in a standard dual gang MK box
- UL listed to Standard 864

Compatibility:

- For use with Simplex® 4100ES, 4010ES, and 4100U Series fire alarm control panels equipped with an MX Loop Module
- Refer to data sheet S4100-0059 for MX Loop Module details


Description

These MX Technology addressable I/O (input/output) modules provide flexible monitoring and control to satisfy a variety of applications. Each is individually addressable and communicates with an MX Loop Module located in the host fire alarm control panel.

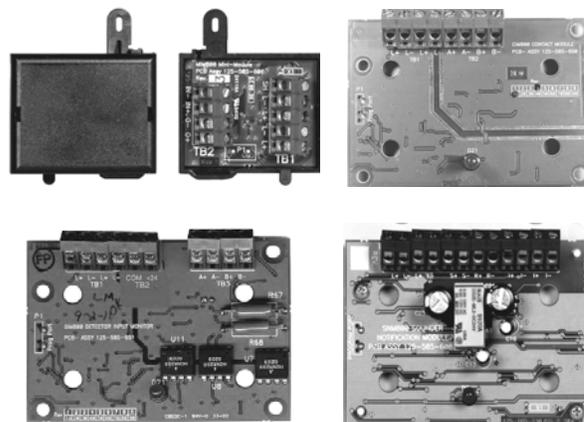

Typical MX Technology I/O Module Assemblies

Product Details

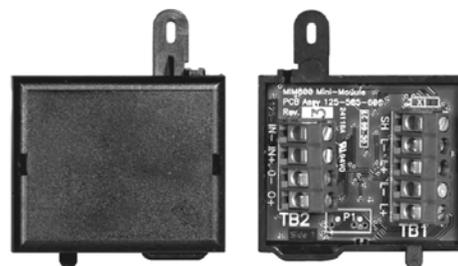


4090-5201 Mini-IAM

4090-5201 Mini-IAM (Individual Addressable Module) Features:

- Small size for single input circuit monitoring of normally open or normally closed contacts
- Provides open and short circuit monitoring of the line
- Fits in small devices such as flow switches, special detection devices, and explosion proof callpoints
- A variation of this module is used in addressable callpoints and pull stations
- Dimensions are 1 7/8" W x 2 5/16" H x 1/2" D (48 mm x 58 mm x 13 mm)
- If mounted separately from the device being monitored, select electrical box with cover plate per dimensions above

* Listings and approvals under Simplex Time Recorder Co. are the property of Tyco Fire Protection Products.


Product Details (Continued)

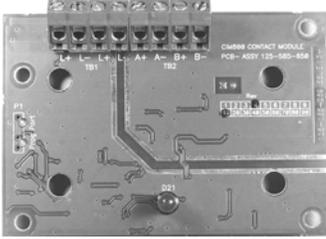

4090-5202 Dual Input IAM

4090-5202, Dual Input IAM Features:

- Two separately wired Class B spur inputs providing open and short circuit line monitoring that can be combined for one Class A input
- Each can be configured to monitor normally open or normally closed inputs
- Both inputs can be configured to initiate an alarm or short circuit fault message in the event of a short circuit on normally open monitoring circuits

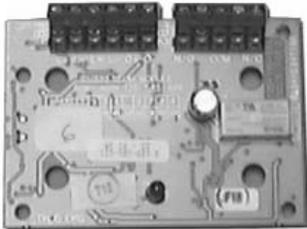

4090-5203 Relay IAM

4090-5203 Relay IAM Features:


- A single relay output programmable from the MX Loop
- Applications include signaling fire conditions to plant, machinery, fire doors, dampers, and security systems
- Relay coil is monitored
- Relay contact is rated for 2A @ 24V DC



4090-5204 Signal IAM

4090-5204 Signal IAM Features:


- Remote addressable NAC spur can be wired Class B or Class A and is rated 2A @ 24V DC for up to 62 appliances; requires a separately wired 24 VDC nominal input
- Can also be used to provide a supervised output for other control applications

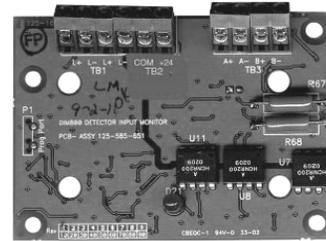

4090-5205 Monitor ZAM

4090-5205 Monitor ZAM (Zone Adapter Module) Features:

- Provides monitoring and zone power for two Class B circuits or one Class A circuit of low voltage conventional detectors and callpoints
- External 24 VDC power is supplied from a 4100-5130 Voltage Regulator Module in the controlling host fire alarm panel
- 24 VDC status is monitored and a fault signal is provided if lost
- Power reset is controlled from the MX Loop module in the host fire control panel.
- Input detection circuit can be wired as one or two spur circuits (Class B), or one 4-wire detection circuit

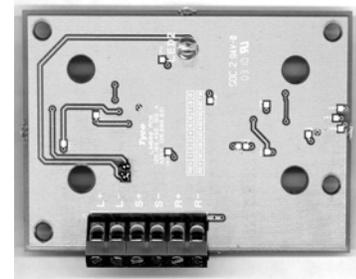

4090-5206 Line Isolator Module


4090-5206 Line Isolator Module Features:

- Monitors the MX Loop line condition for short circuits and provides connection/isolation using solid state switches
- A spur circuit is connected between the input and output switches for connection convenience
- A fault on either the input (Left side) wiring or the output (Right side) wiring opens that switch allowing the spur to continue to operate for loop circuits wired Class A, and also isolates the shorted wiring section from the functioning section
- A fault on the spur circuit opens both switches separating the spur from the rest of the communications loop


Dimension and Installation Reference

Front and Bottom View Reference

(Modules 4090-5202, 4090-5203, 4090-5204, 4090-5205, 4090-5206)

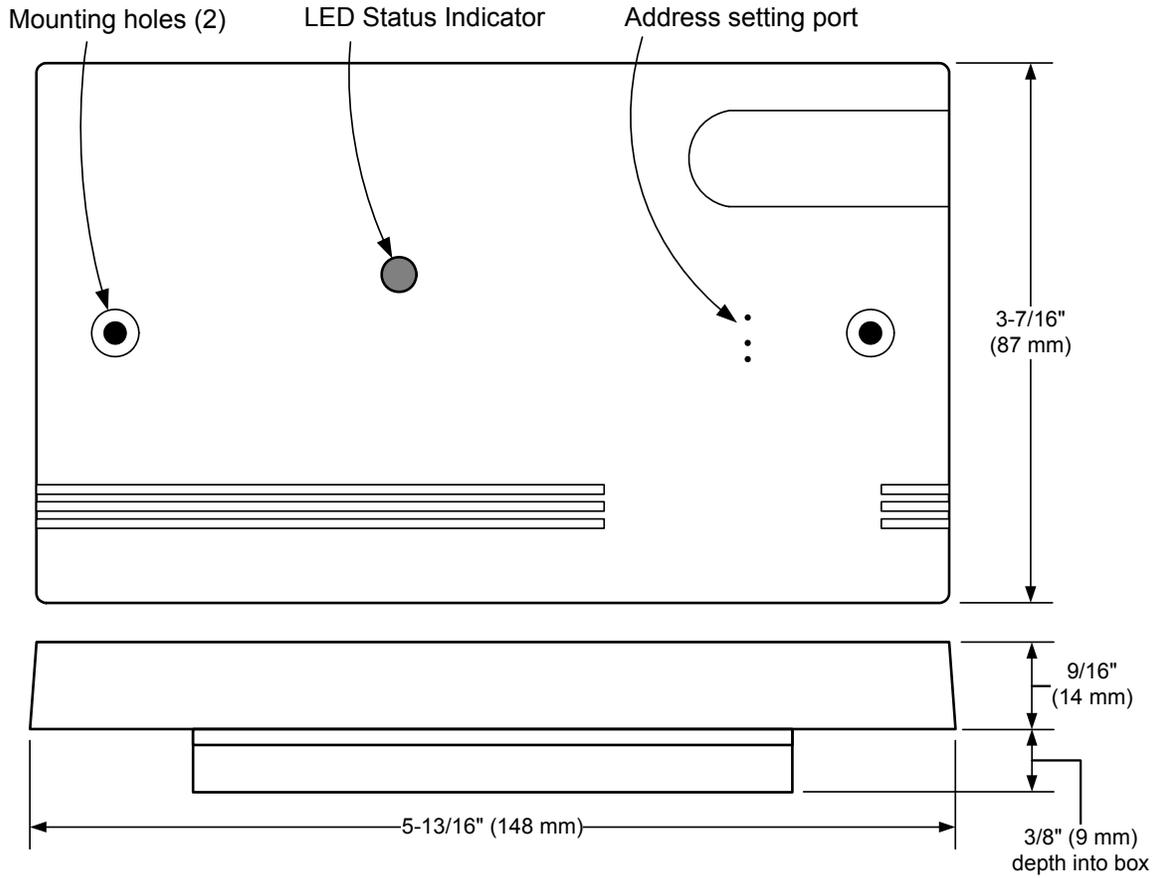

Rear View with typical module (shown without module cover for reference)

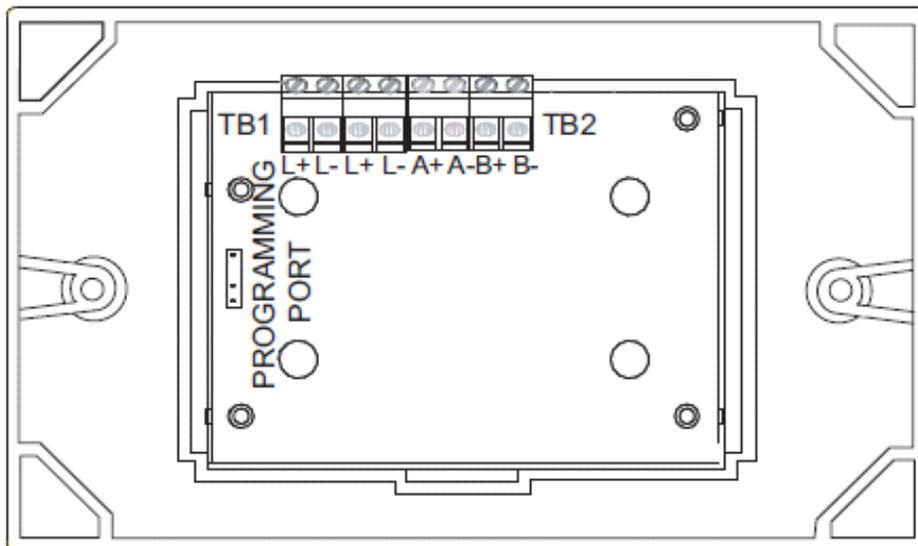

Product Selection

Addressable Input/Output Modules (refer to specific module details on pages 2 and 3)

Model	Description	Installation Instruction Reference
4090-5201	Mini-IAM, supervised contact monitoring module	579-929
4090-5202	Dual Input IAM, dual Class B or single Class A supervised contact monitoring module; Class A monitoring requires EOL resistor assembly 4081-9020	579-927
4090-5203	Relay IAM, contact rated 2 A @ 24 VDC	579-930
4090-5204	Signal IAM, two Class B NACs, or one Class A NAC, rated 2 A @ 24 VDC, up to 62 appliances; Class A output requires EOL resistor assembly 4081-9022 Note: Refer to the Installation Instructions for compatible notification appliances	579-931
4090-5205	Monitor ZAM, two Class B inputs or one Class A input; Class A input requires EOL resistor assembly 4081-9021; Regulated power is required , use the 4100-5130 Voltage Regulator Module in the host panel Note: Refer to the Installation Instructions for two-wire detector compatibility information	579-928
4090-5206	Line Isolator Module	579-935

Accessories

Model	Description
4081-9020	200 Ω, 1%, ½ W resistor
4081-9021	4.7 kΩ, 1%, ½ W resistor
4081-9022	27 kΩ, 1%, ½ W resistor
UL listed, Four Wire End-of-Line Resistor Harness Assemblies; provides two input and two output, color-coded wire leads (red/ black) for in/out wiring with an across-the-line resistor; leads are 6" long (152 mm) with resistor and terminations insulated	
2098-9808	Remote LED on single gang stainless steel plate, optional for use with 4090-5201 Mini-IAM
517.035.007	Replacement Module Front Cover
516.800.918	MX Service Tool, ref. MX Model 801AP
516.800.922	MX Ancillary Program Lead (Spare)
516.800.923	MX Service Tool Accessory Kit

Specifications

(Refer to additional specifications on pages 1, 2, and 3.)

4090-5205 Monitor ZAM	Input Voltage	Nominal voltage = 24 VDC (from 4100-5130 Voltage Regulator Module in the host fire alarm control panel) Minimum voltage = 21.9 VDC Maximum voltage = 26.4 VDC
	Current from MX Loop	Class B standby = 0.28 mA; Class A standby = 0.53 mA
	Current from External 24 VDC Supply	Class B standby = 14 mA; Class A standby = 8.25 mA Class B or Class A alarm = 50 mA per detector (spur) circuit Minimum detector voltage = 18 VDC; maximum detector voltage = 25 V Maximum standby detector load per 4090-5205 = 2.8 mA End-of-Line Resistor for Class B spur circuits = 4.7 kΩ Maximum circuit resistance = 50 Ω
	Note: Does not include detector current	
MX Loop Current	4090-5201, Mini-IAM	0.46 mA in standby, or in alarm without remote LED 4.5 mA in alarm with remote LED
	4090-5202, Dual Input IAM and 4090-5203, Relay IAM	0.5 mA in standby 4.5 mA in alarm
	4090-5204, Signal IAM	1.1 mA in standby 4.5 mA in alarm
	4090-5206, Isolator Module	0.08 mA in standby 6 mA with single trip; 10 mA with double trip (fault on spur circuit)
Mounting box for each full size module; not applicable to the 4090-5201 Mini-IAM		Standard 2-gang MK box
Wiring resistance to monitored circuits		10 Ω maximum
Wiring Connections		Terminal blocks, for wire size 20 to 14 AWG (0.5 to 2.5 mm ²)
Operating Temperature		32° F to 120° F (0° C to 49° C)
Humidity		up to 93% RH at 90° F (32° C)

TYCO, SIMPLEX, and the product names listed in this material are marks and/or registered marks. Unauthorized use is strictly prohibited.



Tyco Fire Protection Products • Westminister, MA • 01441-0001 • USA

S4090-0012-2 3/2012

www.simplexgrinnell.com

© 2011 Tyco Fire Protection Products. All rights reserved. All specifications and other information shown were current as of document revision date and are subject to change without notice.