



E TO OPERATE AS A SINGLE STAGE ALARM IN SUPERVISORY MODE INPUTS SHOULD BE CONNECTED ACROSS TB1 & TB5 ONLY.

DO NOT SCALE 

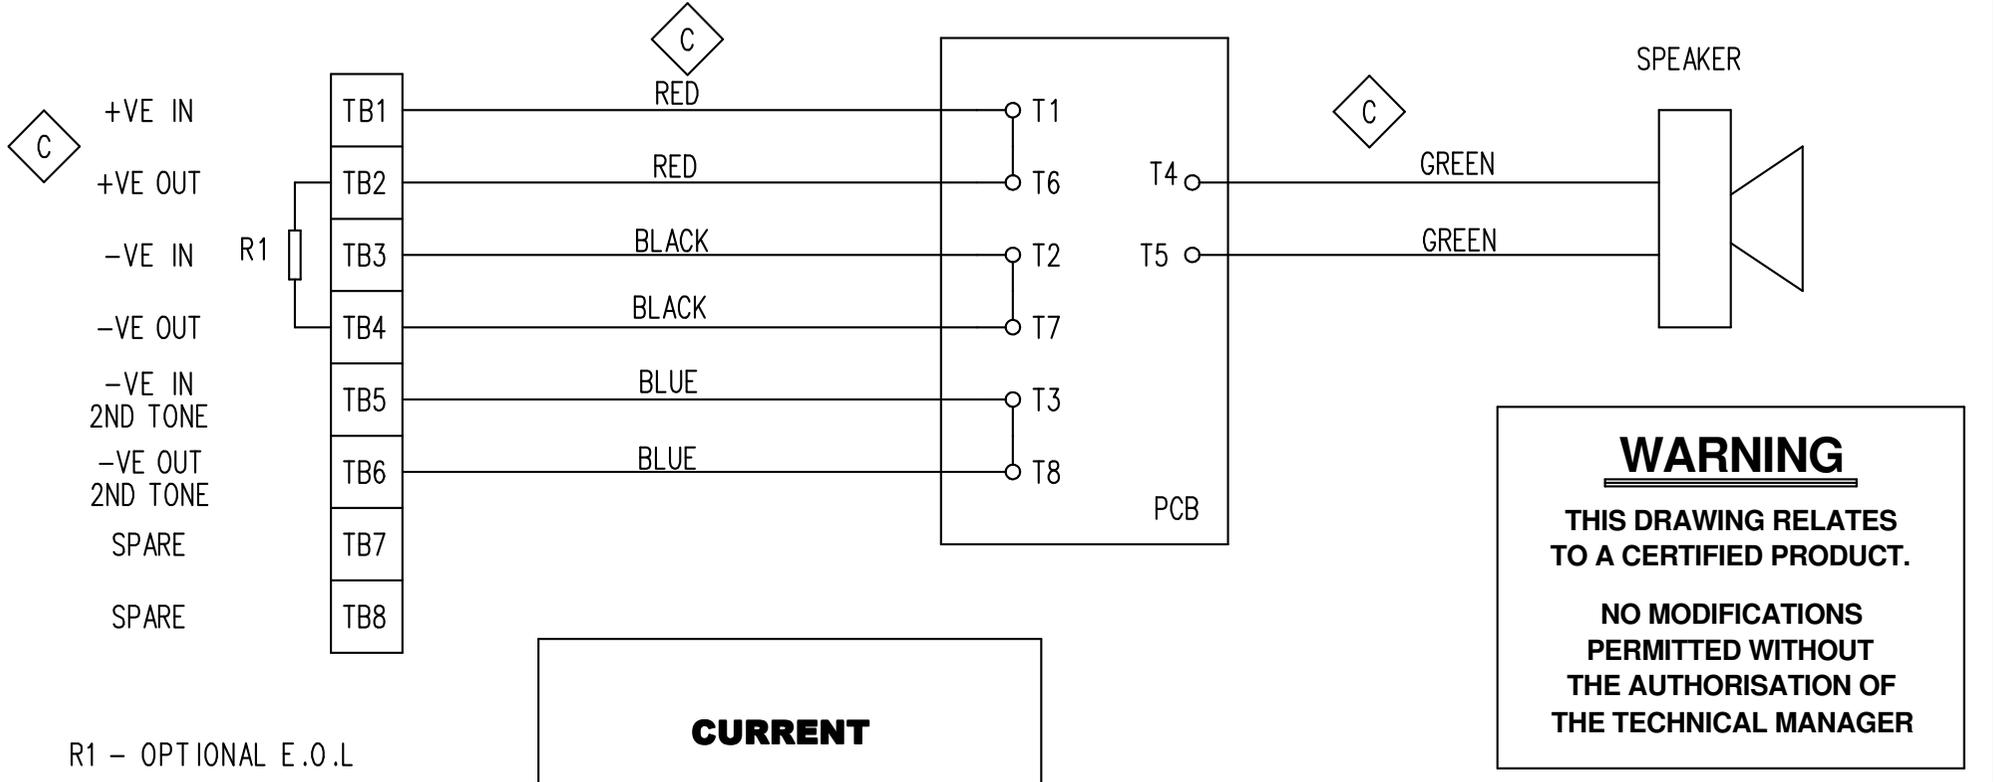

R1 - OPTIONAL E.O.L

G

MEDC MEDC, Colliery Road, Pinxton, Nottingham NG16 6JF, U.K. Tel: +44 (0)1773 812249 fax: +44 (0)1773 580282 DESIGNERS & MANUFACTURERS OF ELECTRICAL & ELECTRONIC EQUIPMENT & SYSTEMS FOR HAZARDOUS AREAS

ISSUES	B. 22-05-00 SH	ALL DIMENSIONS ARE IN MILLIMETRES UNLESS OTHERWISE STATED REMOVE ALL BURRS AND SHARP EDGES MACHINE SYMBOLS THUS 	THIS DRAWING IS CONFIDENTIAL AND IS THE PROPERTY OF MEDC AND MUST NOT BE REPRODUCED EITHER WHOLLY OR PARTLY. ALL RIGHTS IN RESPECT OF PATENTS, DESIGNS AND COPYRIGHT ARE RESERVED.	DRAWN BY: S. HUNT	DATE: 27-04-00	TITLE WIRING DIAGRAM DB1P & DB1HP DC VERSION - DUAL TONE	
	C. 19-04-01 PF			CHECKED BY: B. MALBON	DATE: 27-04-00		
	D. 08-11-02 SH			APPROVED BY: B. TAYLOR	DATE: 27-04-00		
	E. 02-01-03 SH			F. 28-11-03 SO	G. 20-11-08 GE	H. 10-12-08 GE	SCALE: N.T.S.