



May 2023

To whom it may concern,

We constantly strive to improve customer experience and are committed to continuous improvement and innovation.

For your information, SafEye™ Quasar 900 commissioning kit was updated to include all six installation check filters for the factory-calibrated gas types: Methane (888260-1, 888260-2), Propane (888260-3, 888260-4), and Ethylene (888260-5, 888260-6), for warning and alarm levels, respectively.



Figure 1 - Factory-calibrated check filters for all gas types

In addition, we added a universal connection harness for Modbus® / HART® communication with the device (Fig. 2) that replaces both Auxiliary Harness - IS/HART Handheld (888815) and Auxiliary Harness - IS/RS 485 (888816).

888815 and 888816 are now obsolete and have been replaced by 888820.



Figure 2 - Universal connection harness for Modbus® / HART® communication (888820)

The extended commissioning kit will not include a magnet mode selector and back cover opening tool. For signal verification before Zero calibration, please use Modbus® / HART® universal harness (888820).

The functionality, installation, and maintenance practices stay the same.



8200 Market Blvd, Chanhassen, MN 55317 USA

Tel. 973-239-8398 • Fax 973-239-7614

Email: spectrex@spectrex.net

The back cover can be opened by hand without using any tool. If the back cover is tightly closed, please use any suitable tool, as shown in the example illustrated below.

888247-1, 888247-2, and 888247-3 are now obsolete and replaced by 888257- the Extended Quasar 900 commissioning kit.

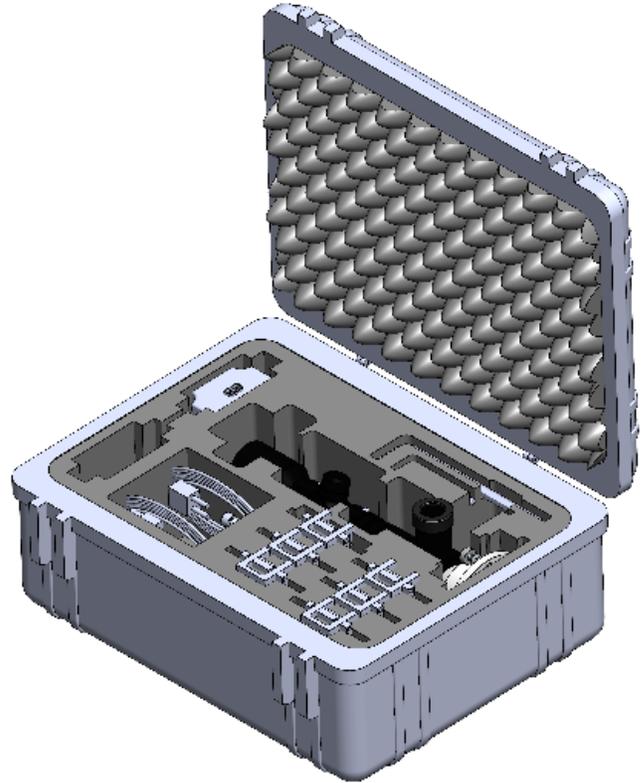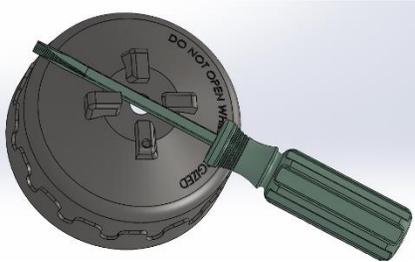

Stay Safe,
Spectrex™

Extended Commissioning Kit (888257)

8200 Market Blvd, Chanhassen, **MN** 55317 USA

Tel. 973-239-8398 • Fax 973-239-7614

Email: spectrex@spectrex.net